



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

O'Hagin Manufacturing, LLC
210 Classic Court, Suite #100
Rohnert Park, CA 94928

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (in Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: O'Hagin's Pitch Perfect (CRS) Metal Ridge Vent for Asphalt Shingle Roofs

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of pages 1 through 6.

The submitted documentation was reviewed by Rafael Macedo.

02/12/26



NOA No. 25-1023.04
Expiration Date: 02/12/31
Approval Date: 02/12/26
Page 1 of 6

ROOFING COMPONENT APPROVAL

Category: Roofing
Sub-Category: Ventilation
Materials: 26 ga. Steel; 0.032" Aluminum; 16 oz. Copper
Minimum Slope: 2:12

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT:

<u>Product</u>	<u>Dimensions</u>	<u>Test Specification</u>	<u>Product Description</u>
O'Hagin's Pitch Perfect (CRS) Metal Ridge Vent for Asphalt Shingle Roofs	Length 50 Inches Width 12 ½ Inches Height ¾ Inch	TAS-100(A)	Galvanized metal, aluminum, or copper ridge attic roof vent.

MANUFACTURING LOCATIONS:

1. Rohnert Park, CA

EVIDENCE SUBMITTED:

<u>Test Agency/Identifier</u>	<u>Name</u>	<u>Report</u>	<u>Date</u>
Intertek	TAS 100(A)	S5306.02-450-18 R3	08/14/25



NOA No. 25-1023.04
Expiration Date: 02/12/31
Approval Date: 02/12/26
Page 2 of 6

APPROVED APPLICATIONS

Tradename: O'Hagin's Pitch Perfect (CRS) Metal Ridge Vent for Asphalt Shingle Roofs

System Type: Mechanical attachment of vent for shingle roofs.

Cutout: Cut air slot after determining the type of framing, either ridge board or truss construction. Ridge board construction slot should be no wider than 3", truss construction slot should be no wider than 1-1/2". Chalk lines & set depth of blade to thickness of roof sheathing. Cut only the required amount of linear feet per calculations, starting from the center of the highest ridge in the attic. Secure the roof sheathing to the roof trusses below the cut lines using locally-approved corrosion-resistant nails or screws of sufficient length to pierce through the roof deck by a minimum of 3/8".

Installation: Secure primary vent specimens to the deck with .114" x 3" ring shank nails 3" from each end and 6" on center thereafter. Secure the vent cover to the primary vent with .114" x 3" ring shank nails with sealant applied at each cover overlap. Install the cap shingles over the vent cover .114" x 3" ring shank nails as seen in **Detail "B"**.

Ridge Shingle: Install pre-manufactured or field-cut ridge shingles over the ridge vent in compliance with the shingle manufacturer's Notice of Acceptance (NOA) and the installation instructions. Ring shank nails shall be corrosion resistant and long enough to penetrate through the wood deck a minimum of 1/8".

Ventilation Calculations: See manufacturer's published literature for net free area.

GENERAL LIMITATIONS:


1. Refer to applicable building code for required ventilation.
2. The installation shall be applied in compliance with the manufacturer's current published application instruction and the requirements set forth in applicable building code.
3. O'Hagin's Pitch Perfect (CRS) Metal Ridge Vent for Asphalt Shingle Roofs is approved to be installed over asphalt shingles only.
4. O'Hagin's Pitch Perfect (CRS) Metal Ridge Vent for Asphalt Shingle Roofs shall not be installed on roof mean heights greater than 75 ft.
5. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule 61G20-3 of the Florida Administrative Code.
6. All approved products listed herein shall be labeled and shall bear the imprint or identifiable marking of the manufacturer's name or logo and following statement: "Miami-Dade County Product Control Approved" or the Miami-Dade County Product Control Seal as shown below.




NOA No. 25-1023.04
Expiration Date: 02/12/31
Approval Date: 02/12/26
Page 3 of 6

DETAIL A


O'Hagin's Pitch Perfect (CRS) Metal Ridge Vent for Asphalt Shingle Roofs

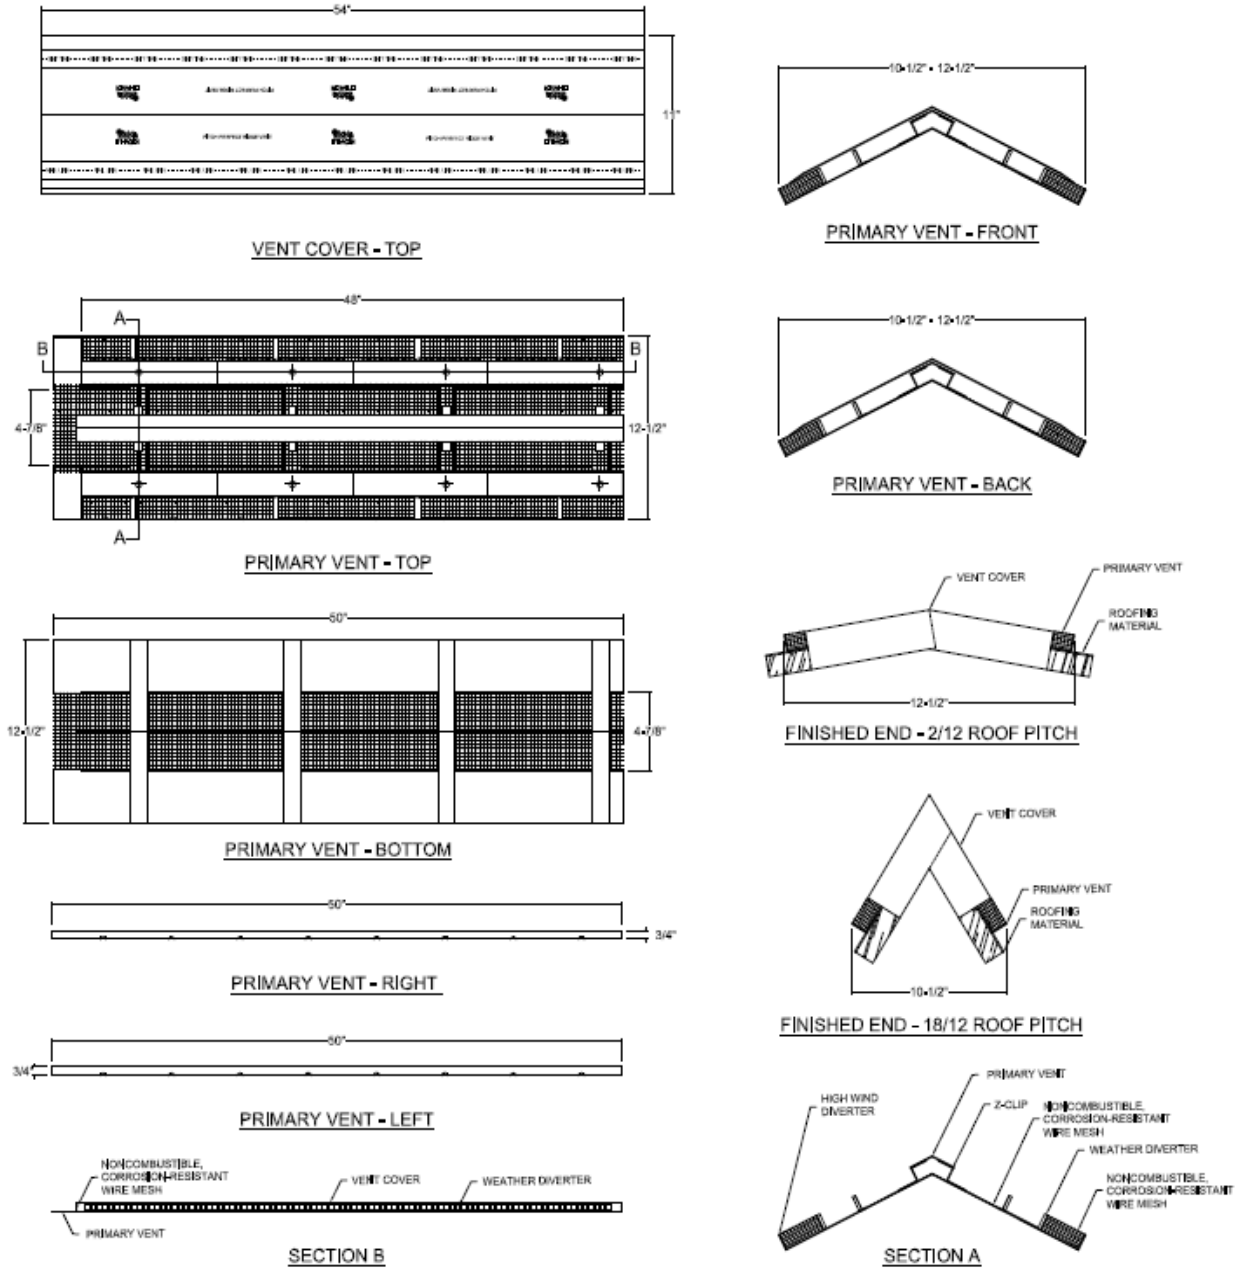

DETAIL B

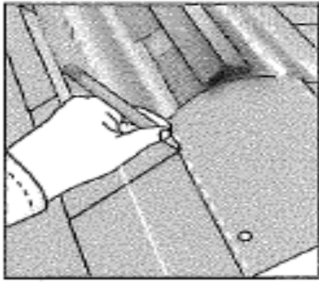


1. MARK alignment & sealant lines on roof deck. Place the primary vent on the ridge, press down firmly on top of the primary vent to conform the vent to the pitch of the roof. Mark leading edge of the primary vent & the nailing slots between the internal diverters (3" from the vents edge towards the slot in the roof ridge). Chalk all lines along the entire length of the ridge.

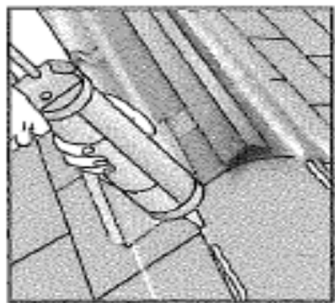


2. SEAL using a continuous bead of locally-approved sealant over the nailing lines along the entire length of the ridge.




3. PLACE primary vent at the end wall or 12" from any hip, chimney or skylight. Align leading edge of primary vent with previously marked layout lines on the roof. Overlap each additional primary vent section with no greater than an 1/8" gap between each primary vent section. Place all preceding primary vent sections in the same manner along the entire length of the ridge.

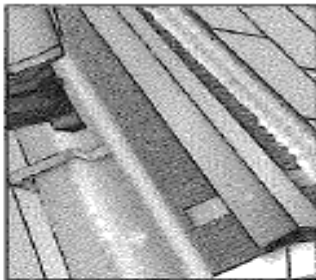

4. INSTALL primary vent with locally approved corrosion-resistant nails or screws of sufficient length to penetrate through the roof deck by a minimum of 3/4". Secure by marking 3" from each side of the primary vent & 6" between marks (3", 9", 15", & 21"). Additional fastening over bullseye marks should enhance sheer strength across the ridge of the structure.

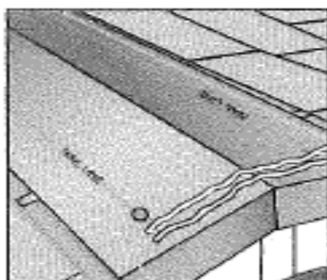

5. SECURE secondary vent "cover" in each corner, along NAIL LINE indicators. Fasten using locally-approved corrosion-resistant nails or screws. Apply two beads (1" apart) of locally-approved sealant at each vent cover overlap (minimum 2"). Ensure a minimum of 2" transition from the top of the primary vent down the rake (gable end) and 12" prior to a hip, chimney or skylight. See steps 5a. End Cap and 5b. Mid Roof transitions below.

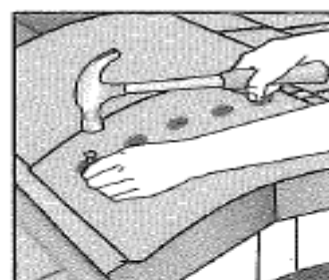


6. COVER vent with ridge cap shingles. Apply locally-approved sealant on top of vent cover, below the starter shingles at each end cap or mid roof transition. Secure ridge cap shingles using 2-1/2" or 3" locally-approved corrosion-resistant nails or screws depending on shingle and deck depth. Ensure the width of ridge cap shingles doesn't block ventilation slot.

END CAP & MID ROOF VENT COVER TRANSITION INSTRUCTIONS

The steeper the roof pitch, the wider the angle on the cut from the edge of vent cover towards the center of the minimum bend mark of 2". MARK the angle of the cut in towards the center of the vent cover, depending on the pitch of the roof. TRIM the angular cuts at the end of the vent cover. BEND both sides of the vent cover down slightly past 90 degrees to close the edge of the primary vent. SEAL all angular cuts on the side under the vent cover. SECURE with four 2-1/2" locally-approved corrosion-resistant nails or screws at each corner of the vent cover. Lastly, cover with ridge cap shingle per manufacturers instructions.

5a. END CAP




MARK



TRIM



BEND



SEAL/SECURE

5b. MID ROOF




MARK



TRIM



BEND



SEAL/SECURE

END OF THIS ACCEPTANCE